


**POLLUTION MONITORING DATA  
HENTY SEWAGE TREATMENT WORKS**

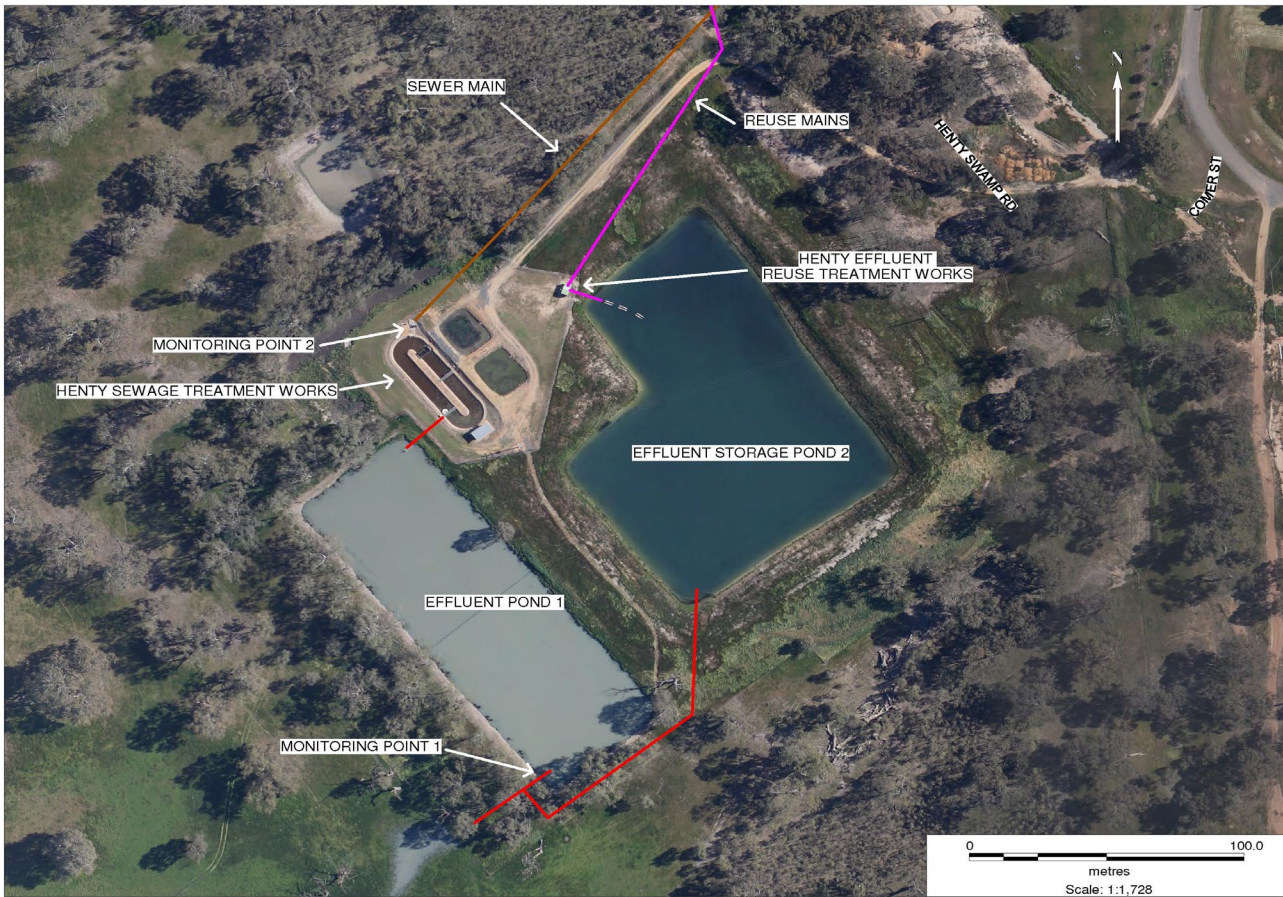

**Environment Protection Licence No.:** 3726

Link to full licence on EPA website:

<http://www.epa.nsw.gov.au/prpoeoapp/ViewPOEOLicence.aspx?DOCID=33963&SYSUID=1&LICID=3726>

**Licensee:** Greater Hume Shire Council, PO Box 99 Holbrook NSW 2644

**Address of facility:** Comer Street, Henty NSW 2658

**Monitoring Point 1**

**Location:** Sampling point prior to discharge from effluent pond 1

**Published:** 22 July 2015

**Obtained:** 19 Feb 2015

**Sampled:** 11 Feb 2015

Pollutant	Unit	Frequency	Measurement	100 percentile limit	Exceedence (yes/no)	Comments
Biochemical oxygen demand	mg/l	Quarterly	5	20	no	
Chlorophyll-a	ug/L	Quarterly	23			
Conductivity	ms/cm	Quarterly	770			
Faecal Coliforms	cfu/100ml	Quarterly	86		no	
Nitrogen (total)	mg/l	Quarterly	1.8	20	no	
Oil and Grease	mg/l	Quarterly	<2	10	no	
pH		Quarterly	8.6			
Phosphorus (total)	mg/l	Quarterly	7.2	10	no	
Total suspended solids	mg/l	Quarterly	14	30	no	As per Licence condition L2.5 (a) (b)