


**POLLUTION MONITORING DATA  
HENTY SEWAGE TREATMENT WORKS**

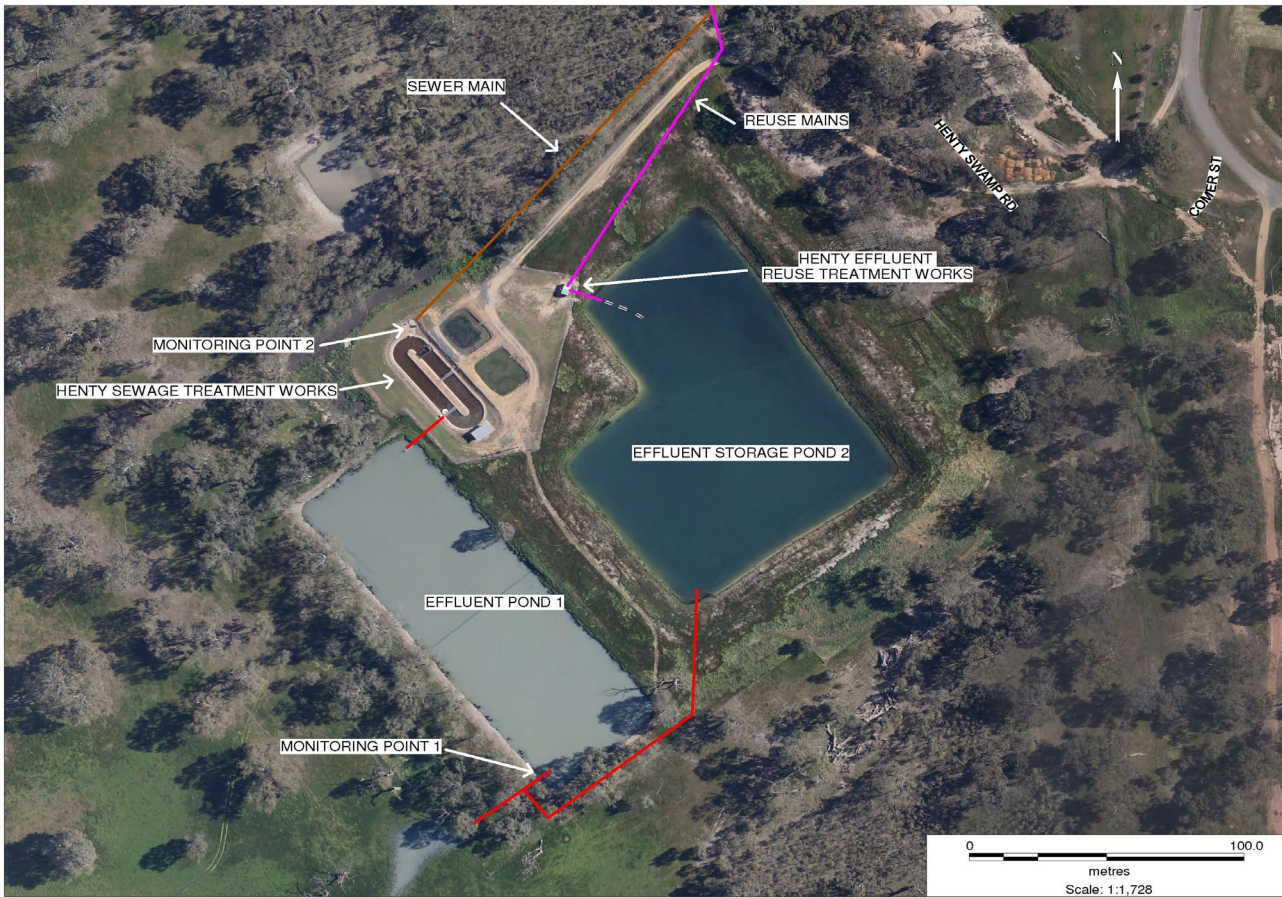

**Environment Protection Licence No.:** 3726

Link to full licence on EPA website:

<http://www.epa.nsw.gov.au/prpoeoapp/ViewPOEOLicence.aspx?DOCID=33963&SYSUID=1&LICID=3726>

**Licensee:** Greater Hume Shire Council, PO Box 99 Holbrook NSW 2644

**Address of facility:** Comer Street, Henty NSW 2658

**Monitoring Point 1**

**Location:** Sampling point prior to discharge from effluent pond 1

**Published:** April 2021

**Obtained:** 24 Feb 2021

**Sampled:** 10 Feb 2021

Pollutant	Unit	Frequency	Measurement	100 percentile limit	Exceedence (yes/no)	Comments
Biochemical oxygen demand	mg/l	Quarterly	10	20	no	As per Licence condition L2.5 (a) (b)
Chlorophyll-a	ug/L	Quarterly	54			
Conductivity	ms/cm	Quarterly	720			
Faecal Coliforms	cfu/100ml	Quarterly	3900		no	
Nitrogen (total)	mg/l	Quarterly	3	20	no	
Oil and Grease	mg/l	Quarterly	<2	10	no	
pH		Quarterly	8.2			
Phosphorus (total)	mg/l	Quarterly	5.7	10	no	
Total suspended solids	mg/l	Quarterly	18	30	no	As per Licence condition L2.5 (a) (b)